




(903) 897-0737 1-866-897-0737
103 W CJ Wise Parkway Mailing Address: P.O. Box 129 Naples, Texas 75568-0129

Notice: This circuit can be modified to compensate for detected Transient Voltage. If you have connected an ISIMET remote panic to this unit at the AUX Panic Connection points at CON4A and intermittent interruption of service is experienced, then connect the relay with the wiring harness provided as show in the drawing. **TURN OFF POWER BEFORE INSTALLING THIS HARNESS.**

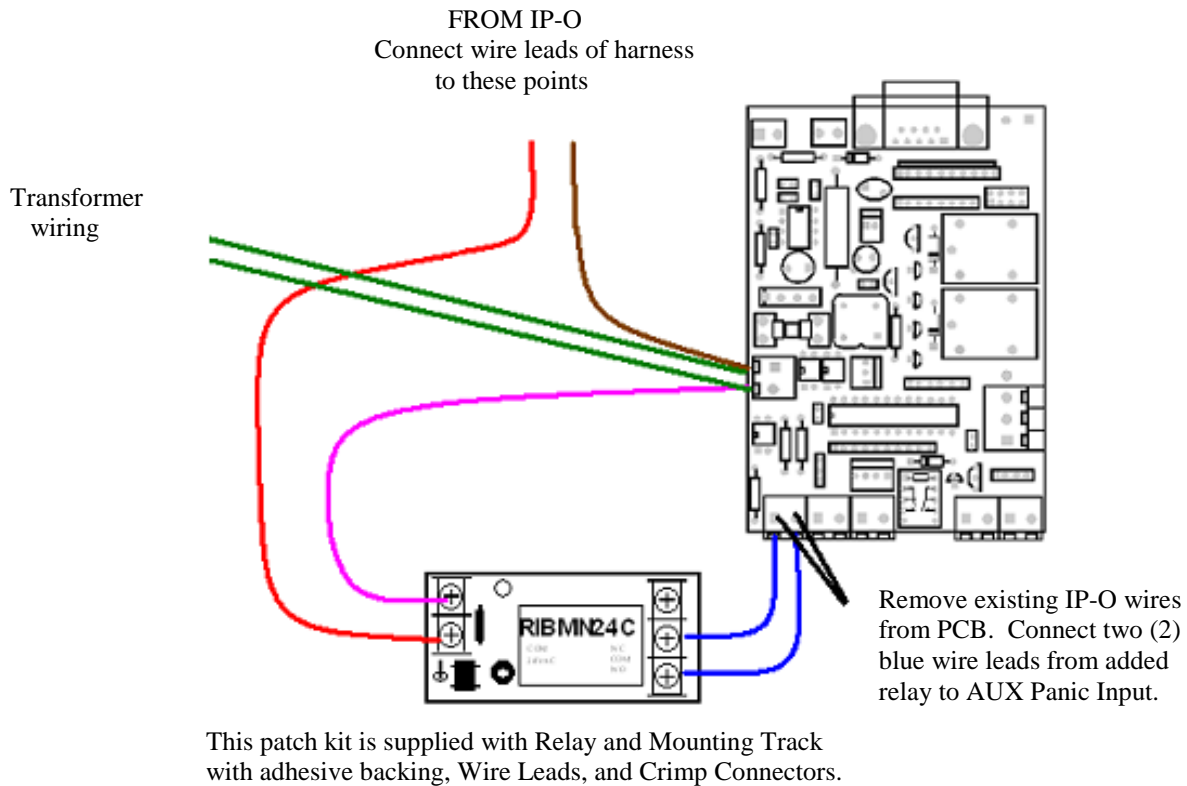

CAUTION: Do not connect an input from a source other than an ISIMET remote source to the Auxiliary input terminals if the Relay and Wiring Harness is in place.